


CompoNet -206	Read Input Terminal Maintenance Counter Present Value: _CompoNet206_GetCounter_IN_PV
--------------------------	---

Basic function	Reads the present values of terminal maintenance counters from slaves connected to CompoNet. Use this FB for input terminals.																																					
Symbol		<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 30%; padding: 2px;">_CompoNet206_GetCounter_IN_PV</td> <td style="width: 30%; padding: 2px;">(BOOL)</td> <td style="width: 30%; padding: 2px;">(BOOL)</td> <td style="width: 10%;"></td> </tr> <tr> <td style="padding: 2px;">EN</td> <td style="padding: 2px;">(INT)</td> <td style="padding: 2px;">ENO</td> <td style="padding: 2px;">(BOOL)</td> </tr> <tr> <td style="padding: 2px;">Master Unit No.</td> <td style="padding: 2px;">MasterUnitNo</td> <td style="padding: 2px;">BUSY</td> <td style="padding: 2px;">Busy Flag</td> </tr> <tr> <td style="padding: 2px;">Slave node address</td> <td style="padding: 2px;">NodeNo</td> <td style="padding: 2px;">OK</td> <td style="padding: 2px;">Normal end</td> </tr> <tr> <td style="padding: 2px;">Terminal No.</td> <td style="padding: 2px;">PinNo</td> <td style="padding: 2px;">NG</td> <td style="padding: 2px;">Error end</td> </tr> <tr> <td style="padding: 2px;">Slave Type</td> <td style="padding: 2px;">NodeType</td> <td style="padding: 2px;">UDINT</td> <td style="padding: 2px;">Present value of maintenance counter</td> </tr> <tr> <td></td> <td></td> <td style="padding: 2px;">PV</td> <td style="padding: 2px;">FINS error code (May be omitted.)</td> </tr> <tr> <td></td> <td></td> <td style="padding: 2px;">FINSError</td> <td style="padding: 2px;">Explicit message error code (May be omitted.)</td> </tr> <tr> <td></td> <td></td> <td style="padding: 2px;">ExplicitError</td> <td></td> </tr> </table>	_CompoNet206_GetCounter_IN_PV	(BOOL)	(BOOL)		EN	(INT)	ENO	(BOOL)	Master Unit No.	MasterUnitNo	BUSY	Busy Flag	Slave node address	NodeNo	OK	Normal end	Terminal No.	PinNo	NG	Error end	Slave Type	NodeType	UDINT	Present value of maintenance counter			PV	FINS error code (May be omitted.)			FINSError	Explicit message error code (May be omitted.)			ExplicitError	
_CompoNet206_GetCounter_IN_PV	(BOOL)	(BOOL)																																				
EN	(INT)	ENO	(BOOL)																																			
Master Unit No.	MasterUnitNo	BUSY	Busy Flag																																			
Slave node address	NodeNo	OK	Normal end																																			
Terminal No.	PinNo	NG	Error end																																			
Slave Type	NodeType	UDINT	Present value of maintenance counter																																			
		PV	FINS error code (May be omitted.)																																			
		FINSError	Explicit message error code (May be omitted.)																																			
		ExplicitError																																				
File name	Lib\FBL\omronlib\RemoteIO\CompoNet_CompoNet206_GetCounter_IN_PV10.cxf																																					
Applicable models	Applicable Master Units	CS1W-CRM21 and CJ1W-CRM21																																				
	Applicable Slave Units	CRT1-ID16, CRT1B-ID02S, CRT1B-ID02SP, CRT1B-ID04SP, CRT1B-MD04SLP																																				
	CPU Unit	CS1*-CPU**H Unit version 3.0 or higher CJ1*-CPU**H Unit version 3.0 or higher CJ1M-CPU** Unit version 3.0 or higher CP1H																																				
	CX-Programmer	Version 5.0 or higher.																																				
Conditions for usage	<p>CPU Unit Settings</p> <p>PLC Setup: Shared Settings for Communications Instructions in FBs</p> <ul style="list-style-type: none"> • CompoNet Response Timeout Time (default: 2 s) 10 s recommended • Number of retries (default: 0) <p>Shared Resources</p> <ul style="list-style-type: none"> • Communications ports (internal logical ports) <p>Other</p> <ul style="list-style-type: none"> • Communications must be within one network and cannot cross to another network. 																																					
Function description	<p>The present value of the maintenance counter is read from the CompoNet slave specified by the Master Unit No., the Slave Node Address and Slave Type.</p> <p>Refer to the FINS error code and explicit message error code if an error occurs.</p> <p>Both error codes will be output as #0000 for a normal end.</p>																																					
FB precautions	<ul style="list-style-type: none"> • The FB is processed over multiple cycles. The BUSY output variable can be used to check whether the FB is being processed. • OK or NB will be turned ON for one cycle only after processing is completed. Use these flags to detect the end of FB processing. <p>Timechart</p>																																					
EN input condition	Connect EN to an OR between an upwardly differentiated condition for the start trigger and the BUSY output from the FB.																																					
Restrictions Input variables	<ul style="list-style-type: none"> • Always use an upwardly differentiated condition for EN. • If the input variables are out of range, the ENO Flag will turn OFF and the FB will not be processed. 																																					
Output variables	<ul style="list-style-type: none"> • This FB requires multiple cycles to process. Always connect an OR including the BUSY output variable to the EN input variable to ensure that the FB is processed to completion (see <i>Symbol</i>). • Do not turn the BUSY output variable ON or OFF outside the FB. 																																					

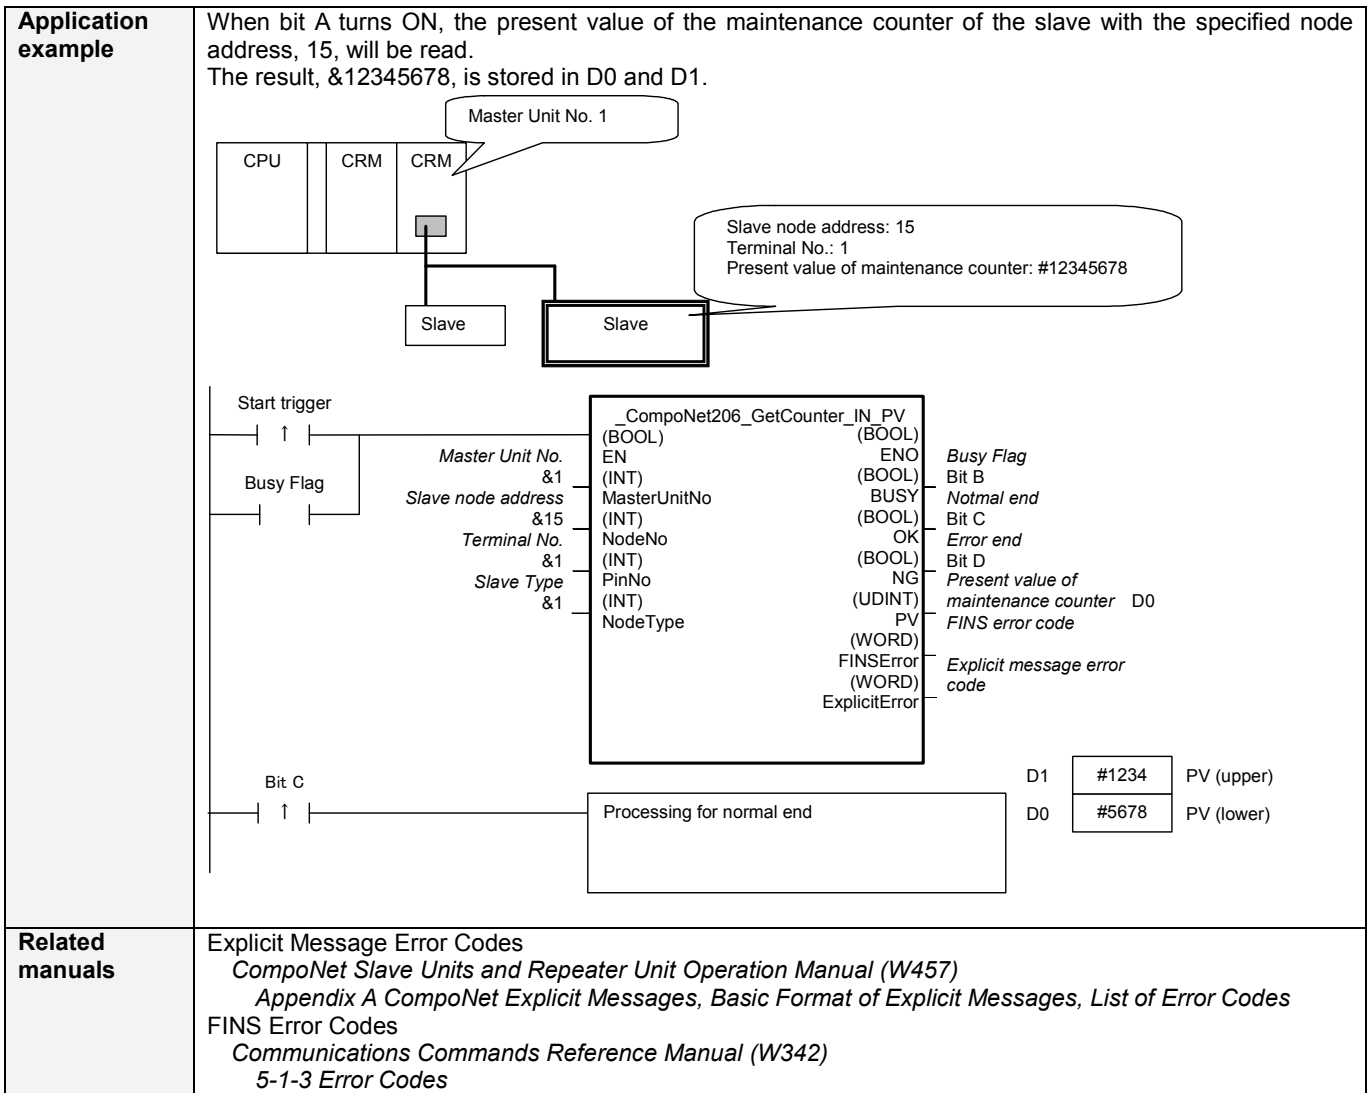

Variable Tables**Input Variables**

Name	Variable name	Data type	Default	Range	Description
EN	EN	BOOL			1 (ON): FB started. 0 (OFF): FB not started.
Master Unit No.	MasterUnitNo	INT	&0	&0 to &99 � to ?	Specify the unit number of the CompoNet Master Unit.
Slave node address	NodeNo	INT	&0	&0 to &127	Specify the node address of the slave.
Terminal No.	PinNo	INT	&0	&0 to &31	The terminal (pin) number for which the present value is to be read.
Slave Type	NodeType	INT	&1	&1 to &7	Slave Type 1: Word Slave IN 2: Word Slave OUT 3: Word Slave MIX 4: Bit Slave IN 5: Bit Slave OUT 6: Bit Slave MIX 7: Repeater

Output Variables

Name	Variable name	Data type	Range	Description
ENO (May be omitted.)	ENO	BOOL		1 (ON): FB processed normally. 0 (OFF): FB not processed or ended in an error.
Busy Flag	BUSY	BOOL		Automatically turns OFF when processing is completed.
Normal end	OK	BOOL		Turns ON for one cycle when processing ends normally.
Error end	NG	BOOL		Turns ON for one cycle when processing ends in an error.
Present value of maintenance counter	PV	UDINT		The present value of the maintenance counter is output. The present value is either the total ON time or the number of operations. (Unit: seconds for total ON time, operations for the number of operations)
FINS error code (May be omitted.)	FINSError	WORD		The FINS error code is output. A code of #0000 is output for a normal end. Refer to the Related Manuals for details on the error codes.
Explicit message error code (May be omitted.)	ExplicitError	WORD		Outputs the explicit message error code. A code of #0000 is output for a normal end. Refer to the Related Manuals for details on the error codes.

Version History

Version	Date	Contents
1.00	2006.9.	Original production

Note

This manual is a reference that explains the function block functions.

It does not explain the operational limitations of Units, components, or combinations of Units and components. Always read and understand the Operation Manuals for the system's Units and other components before using them.