
## Clearing Light Off: \_ExxDRT005\_StopLightOff

Basic function	Clearing the Light OF	F command on the light of a Digital Type Sensor in the DeviceNet network.				
Symbol	Start Trigger	_ExxDRT005_StopLightOff				
-	<b>│</b>	(BOOL) (BOOL)				
	Duoy Flor	EN ENO (INT) (BOOL)				
	Busy Flag Ma	Ister Unit number MasterUnitNo FB_BUSY FB Busy Flag				
	Sla	ave node address (INT) (BOOL) FB Normal End				
		NodeNo FB_OK I B NodeNo (INT) (BOOL)				
	Sensor Amp	liffer unit number — SensorUnitNo FB_NG FB Error End				
File name		talTypeSensor\ExxDRT\_ExxDRT005_StopLightOff10.cxf				
Applicable	Applicable Master					
models	Units	E3X-DRT21-S				
	Applicable Slave Units					
	Applicable Sensor	E3X Series: E3X-DA-S, E3X-MDA, E3X-DATW-S, and E3X-DARM-S				
	Amplifiers	E3C Series: E3C-LDA two-output models and E3C-LDA input models. E2C Series: Not supported.				
	CPU Unit	CS1*-CPU**H Unit version 3.0 or higher				
		CJ1*-CPU**H Unit version 3.0 or higher				
		CJ1M-CPU** Unit version 3.0 or higher				
	0)/ 5	CP1H				
Conditions	CX-Programmer	Version 5.0 or higher				
for usage	Sensor	e is connected when the power is turned ON, the function cannot be used because				
lor dougo		annot be established with the Sensor.				
		be in RUN mode. The function cannot be used when the Sensor is in another mode,				
	i.e., SET mode.					
	CPU Unit Settings	10.4% on for O consistent and leaf of ED.				
		Settings for Communications Instructions in FBs				
		nse Timeout Time (default: 2 s) 10 s or higher is recommended.				
	Number of retries					
	Shared Resources	(				
	Communications ports (internal logical ports)					
	Other					
Function	<ul> <li>Communications must be within one network and cannot cross to another network.</li> <li>Clearing the Light OFF command on the light of the Sensor Amplifier in the DeviceNet network with the</li> </ul>					
description	specified Master Unit number, Slave node address, and Sensor Amplifier unit number.					
FB		ed over multiple cycles. The FB_BUSY output variable can be used to check whether				
precautions	the FB is being pro	ocessed.				
	• FB_OK or FB_NG will be turned ON for one cycle only after processing is completed. Use these flags to					
	detect the end of F ■ Timing Chart	-B processing.				
	Start Trigger	ON				
	33	OFF				
	FB Busy Flag (FB_BUSY					
		OFF				
	FB Normal End (FB OK	) or FB ON				
	Error End (FB_NG)	OFF				
		When the FB Normal End Flag goes ON, the results of the FB				
		processing are reflected in the Sensor Amplifier.				
EN input		between an upwardly differentiated condition for the start trigger and the FB_BUSY				
condition	output from the FB.	Property of the second				
Restrictions		wardly differentiated condition for EN.				
Input variables	It the input variable	es are out of range, the ENO Flag will turn OFF and the FB will not be processed.				
Output	This FB requires n	nultiple cycles to process. Always connect an OR including the FB_BUSY output				
variables		input variable to ensure that the FB is processed to completion (see <i>Symbol</i> ).				
	Do not turn the FB	B_BUSY output variable ON or OFF outside the FB.				
	<del></del>					

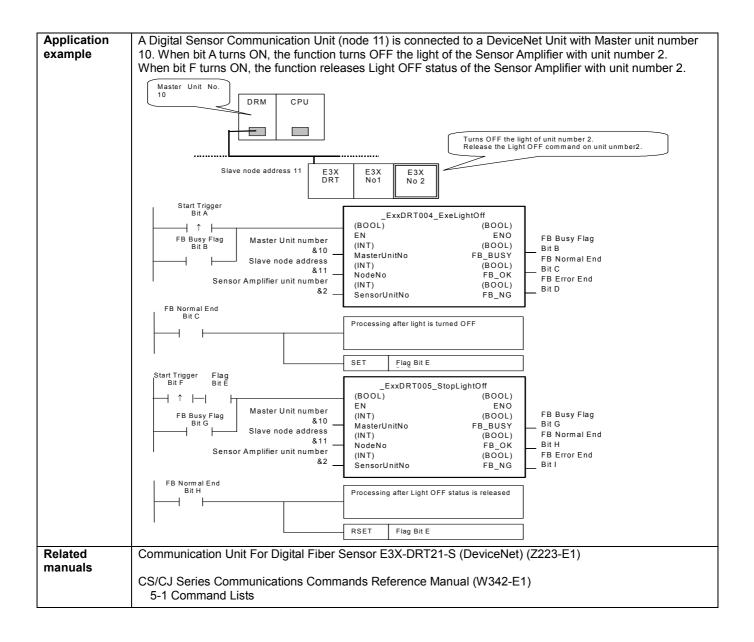

## Variable Tables Input Variables

Name	Variable name	Data type	Default	Range	Description
EN	EN	BOOL			1 (ON): FB started 0 (OFF): FB not started.
Master Unit No.	MasterUnitNo	INT	&0	&0 to &15 #0 to #F	Specify the unit number of the DeviceNet Unit.
Slave node address	NodeNo	INT	&0	&0 to &63	Specify the node address of the slave.
Sensor Amplifier unit number	SensorUnitNo	INT	&1	&1 to &13 or &1 to &16	Depending on the communication mode setting, the maximum number of connectable Units is either 13 or 16 Units. Specify a unit number within the allowed range.  Refer to the <i>Related Manuals</i> for details.

**Output Variables** 

Name	Variable name	Data type	Range	Description
ENO	ENO	BOOL	_	1 (ON): FB processed normally.
(May be omitted.)				0 (OFF): FB not processed or ended in an error.
FB Busy Flag	FB_BUSY	BOOL		Automatically turns OFF when processing is completed.
FB Normal End	FB_OK	BOOL		Turns ON for one cycle when processing ends normally.
FB Error End	FB_NG	BOOL		Turns ON for one cycle when processing ends in an error.

## **Internal Variables**

Internal variables are not output from the FB.

If the FB\_NG Flag turns ON, the following internal variables can be monitored to obtain information on the error.

Name	Variable name	Data type	Range	Description
FINS error code	FINS_ErrorCode	WORD		The FINS error code is output. A code of #0000 is output for a normal end. Refer to the <i>Related Manuals</i> for details on the error codes.
Explicit message error code	Explicit_ErrorCode	WORD		Outputs the explicit message error code. A code of #0000 is output for a normal end. Refer to the <i>Related Manuals</i> for details on the error codes.

**Explicit Error Code Details** 

Explicit Error Code Details				
Code	Contents	Meaning		
#0000	Normal end			
#16FF	No Sensor Amplifier	There is no Sensor Amplifier with the specified unit number.		
#0CFF	Not executable	<ul> <li>The specified command cannot be executed.</li> <li>A Mobile Console is connected.</li> <li>There is an error in communications with the Sensor Amplifier.</li> </ul>		
		<ul> <li>The Sensor Amplifier is in an operation mode other than RUN mode.</li> <li>The FB was executed for a Sensor Amplifier that is not supported.</li> </ul>		
#20FF	Not supported.	The specified command is not supported.		

**Version History** 

Version	Date	Contents
1.00	2005.4.	Original production

## Note

This manual is a reference that explains the function block functions.

It does not explain the operational limitations of Units, components, or combinations of Units and components. Always read and understand the Operation Manuals for the system's Units and other components before using them.